REQUIRED LOCATIONS FOR FIRE HYDRANT MARKERS *

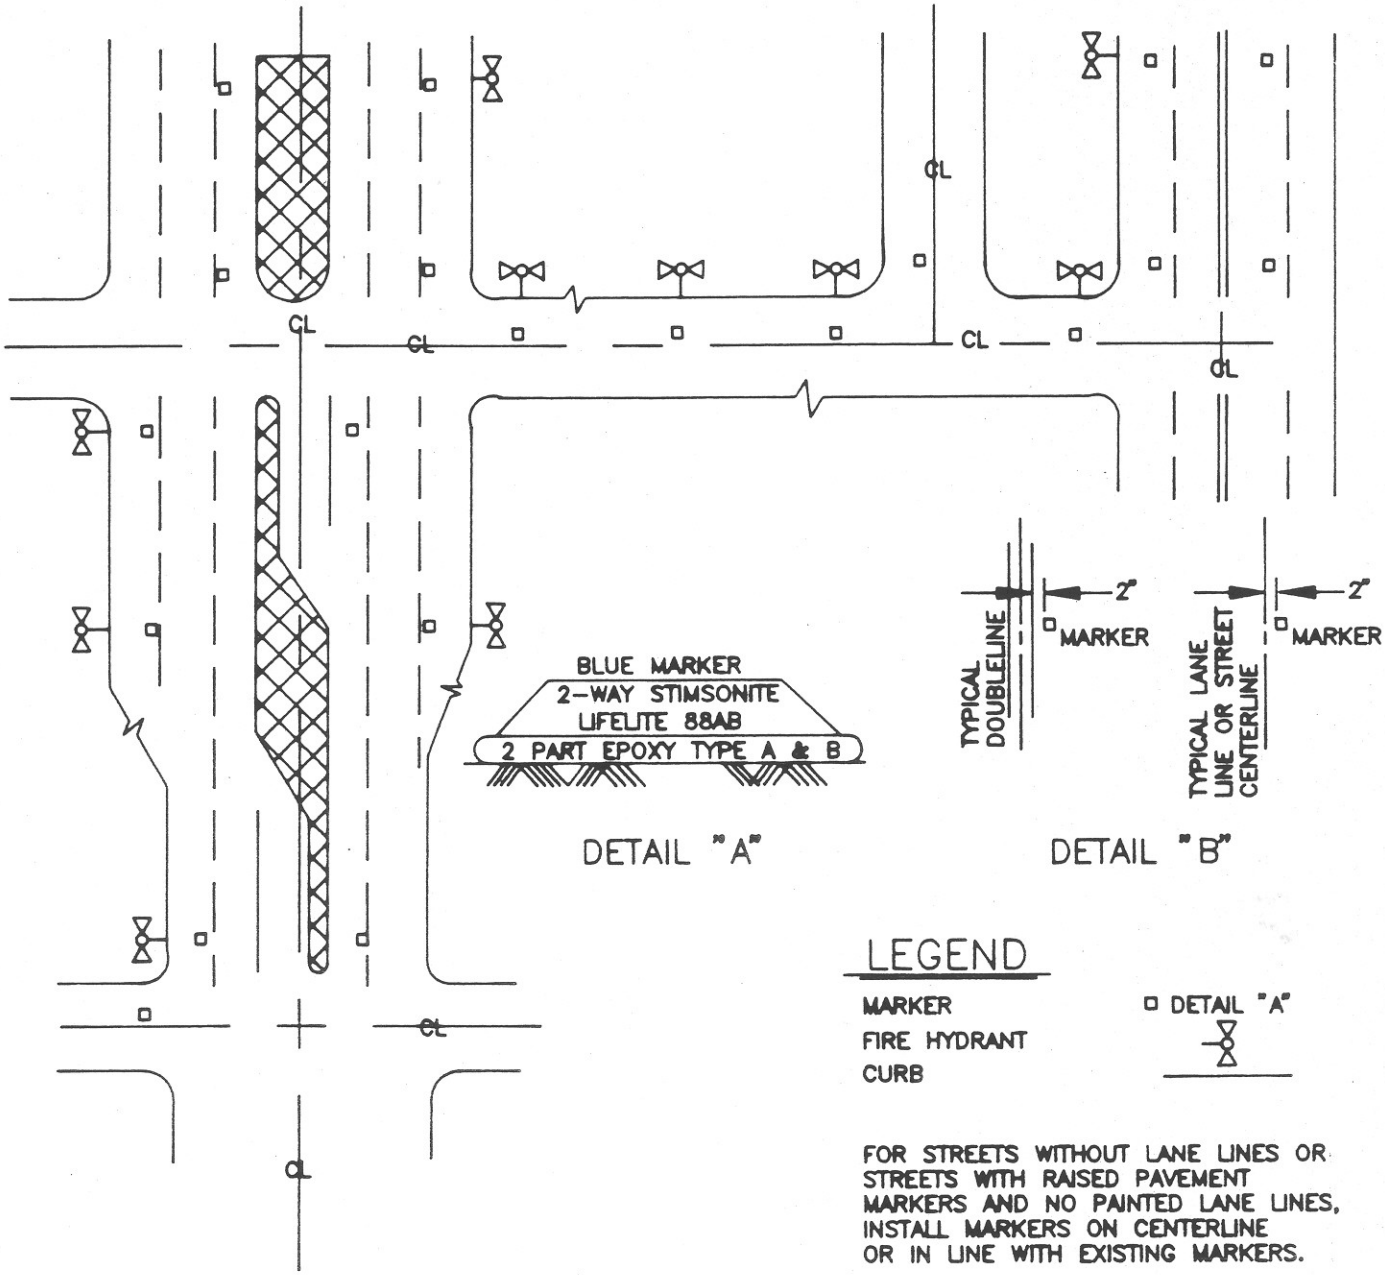

LEGEND

MARKER
FIRE HYDRANT
CURB

□ DETAIL "A"

FOR STREETS WITHOUT LANE LINES OR STREETS WITH RAISED PAVEMENT MARKERS AND NO PAINTED LANE LINES, INSTALL MARKERS ON CENTERLINE OR IN LINE WITH EXISTING MARKERS.

NOTE: FIRE HYDRANTS SHALL BE LOCATED PER SUPPLEMENTAL DRAWING NO. W-2

* FIRE DEPARTMENT WILL PROVIDE LOCATION(S) FOR ALL MARKERS IN PRD'S, COMMERCIAL LOTS AND ALL OTHER AREAS OUTSIDE OF PUBLIC RIGHT OF WAY.

MARKERS MUST BE INSTALLED AT ALL NEW AND RELOCATED HYDRANTS AND WITHIN ALL RESURFACING PROJECTS.

MARKERS– SHALL BE BLUE 2-WAY STIMSONITE LIFELITE 88 AB OR EQUAL.

ADHESIVE– AN AMPLE AMOUNT OF TWO PART (A & B) EPOXY OR EQUAL.

SURFACES– CLEAN AND DRY PRIOR TO INSTALLATION PER MANUFACTURER'S RECOMMENDATIONS. INSTALL MARKERS WITH REFLECTIVE SURFACES FACING ONCOMING TRAFFIC AND OFFSET 2" FROM LANE LINES.

Revision	By	Approved	Date

CITY OF OCEANSIDE

Ronald A Beck
CITY ENGINEER 12/2/92 Date

FIRE HYDRANT MARKER LOCATION

STANDARD DRAWING NO. M-13